DC Research in North America: A Status Report

Chris Marnay & Daniel Gerber

Lawrence Berkeley National Laboratory

NEDO, Kawasaki, Japan
24 May 2019

UNIVERSITY OF CALIFORNIA

ChrisMarnay@LBL.gov
+1.510.486.7028

Outline

2 slides
- changing paradigms (Chris)

9 slides
- North American demos (Chris)

1 slide
- US academic research (Daniel)

2 slides
- DOE/CEC/other programs (Daniel)

3 slides
- LBNL-NREL work (Daniel)

1 slide
- Fort Collins Symposium (Chris)

Heterogeneous PQR

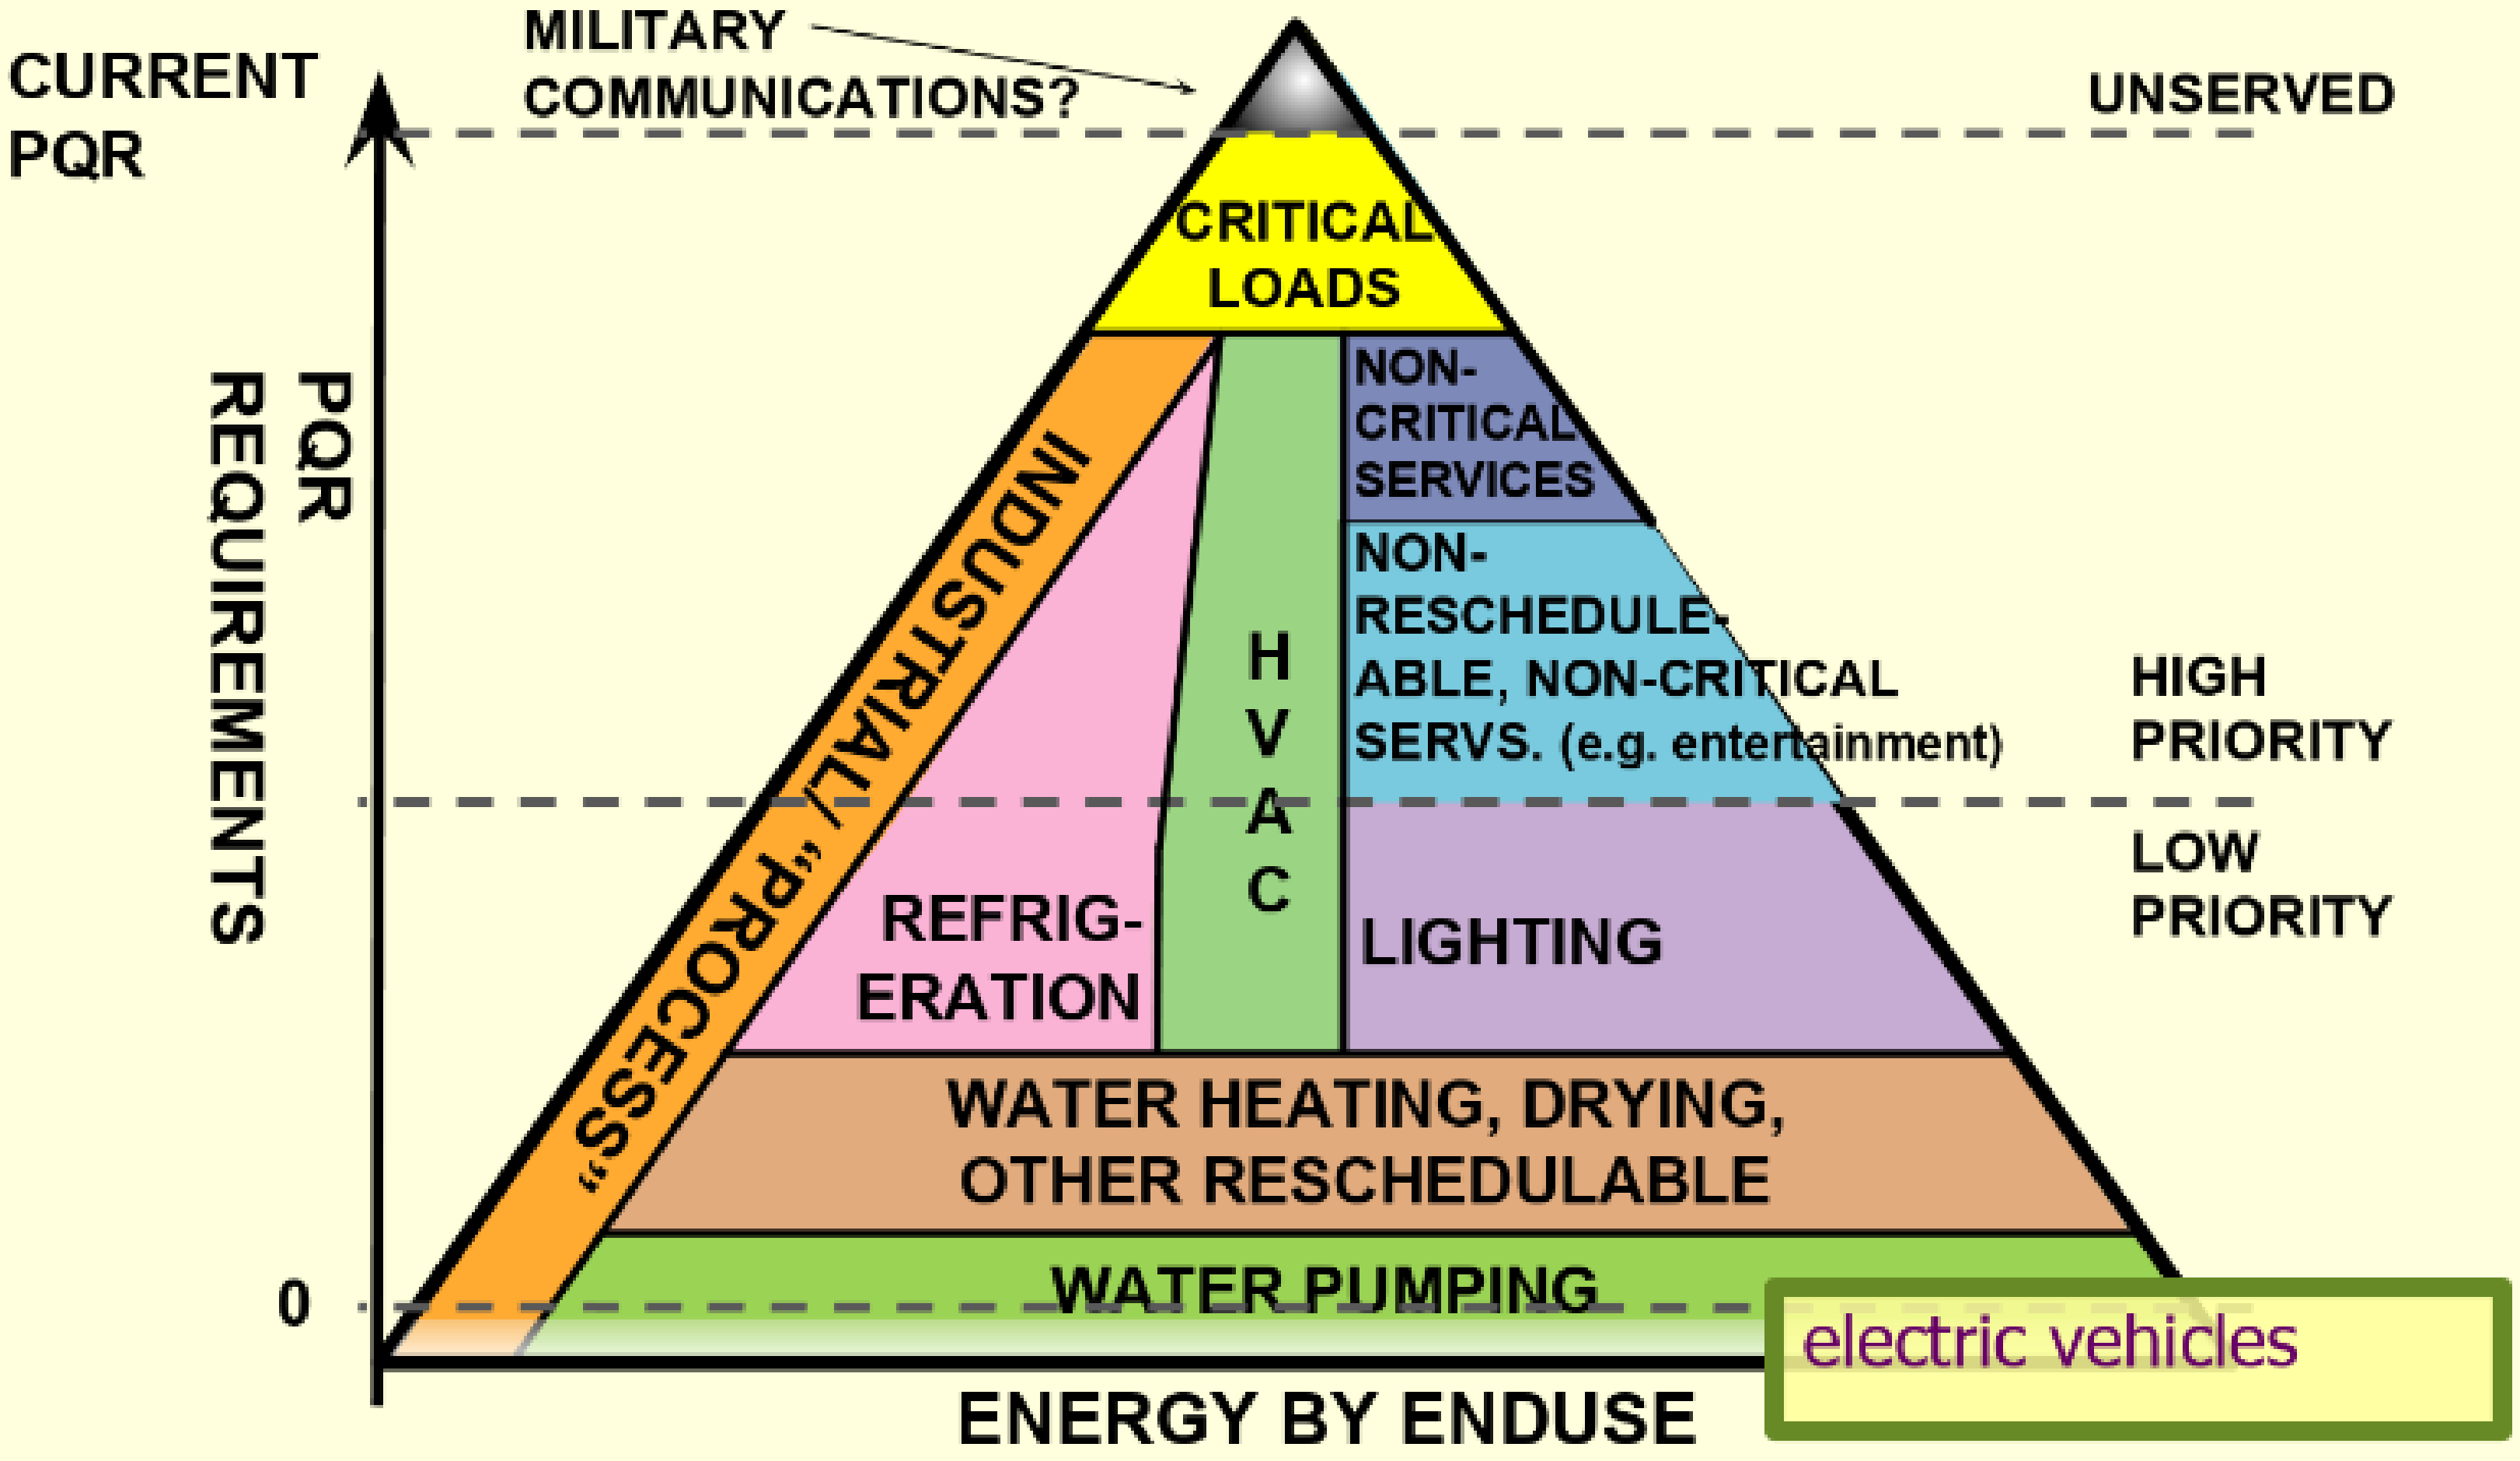

Sendai Microgrid Schematic

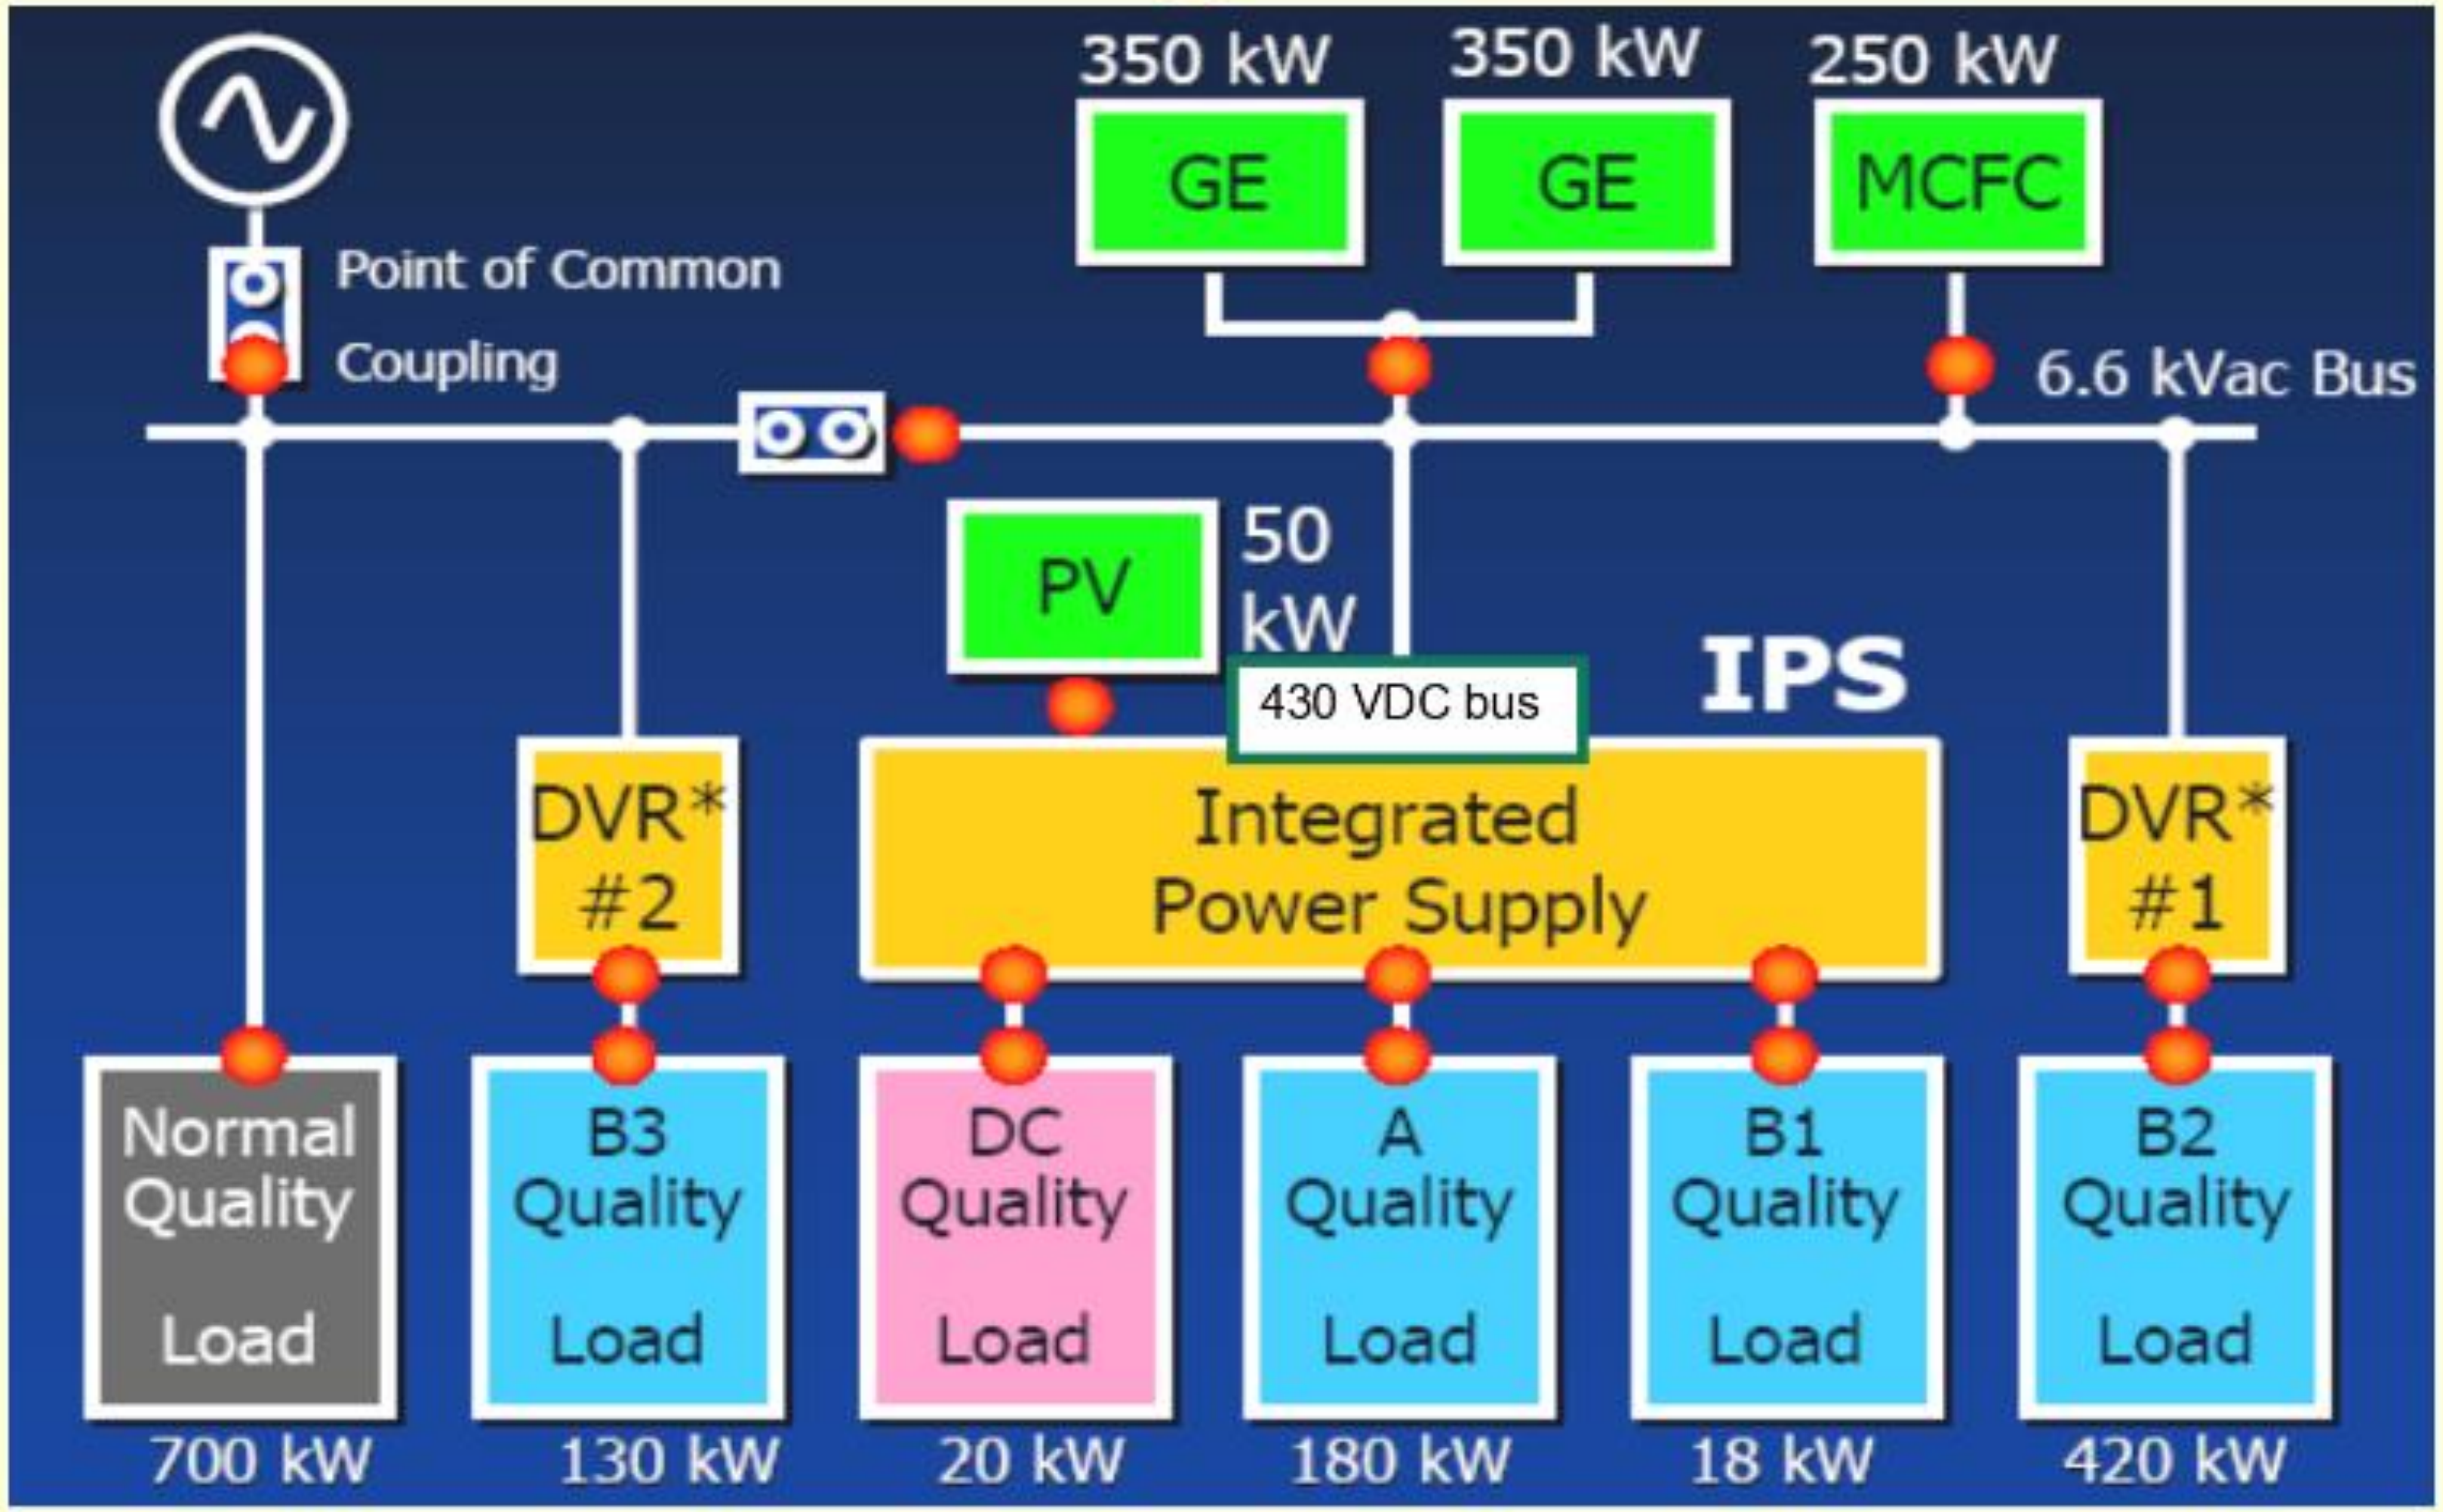

Sinclair Hotel, Dallas TX 1

- 1930’s Art Deco historic hotel
- 16-storys, 165 rooms
- roof-top bar, no PV, 3-p 208V
- 0.8 mm^2 wiring (no conduit)
  48 V POE over all building
- AC exceptions: elevators, TVs,...

  - cordless hair dryer, iron, ...
  - workout energy collection
  - 332 kWh, 1 MW battery
  - 25% less lighting install cost
  - energy savings? shedding?

Sinclair Hotel, Dallas TX 2

Bosch, Ontario CA (Los Angeles) 1

286 kW PV array (600 Vdc)

180 kW Li-ion / 540 kWh (LG chem battery)

120 kW DC Powerservers (AC-DC - for power from grid)

180 kW bi-directional converters (storage and AC loads)

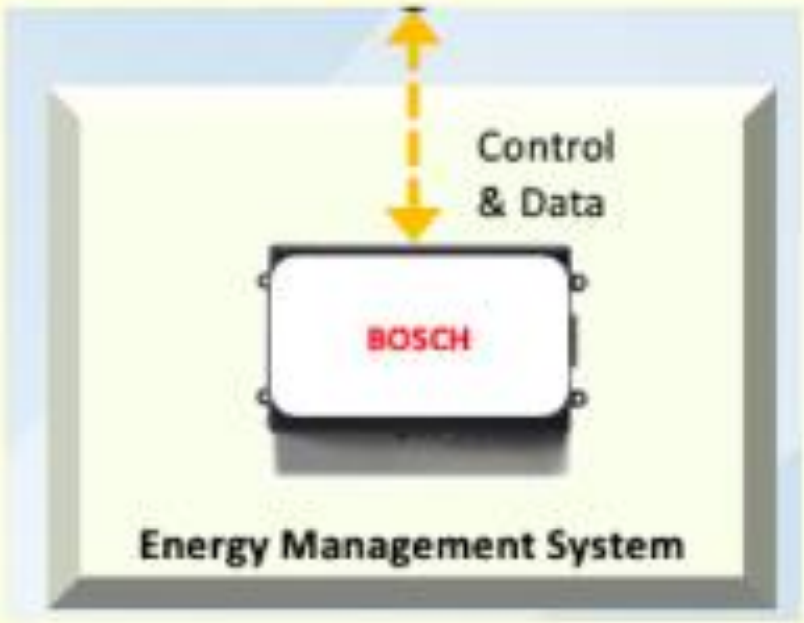

625 x 380 Vdc, 204 W light fixtures

11 x 380 Vdc, 1.5 kW industrial fans

12 x 380 Vdc, 7.5 kW)

- 380 DC only, warehouse loads
- 21% less energy, lower variability, resiliency

Bosch, Chino CA (Los Angeles) 2

Keating Gym Nanogrid, IIT Chicago 1

- a local network able to island
- 180 kW PV, building peak 90 kW
- sodium-ion batteries
- advanced controls
- hybrid circuits
- energy savings?

Keating Gym Nanogrid, IIT Chicago 2

Silver Cloud Winery, Sonoma Co, California 1

Silver Cloud Winery, Sonoma Co, California 2

Silver Cloud single line diagram

March 15th 2019

Jorge Elizondo

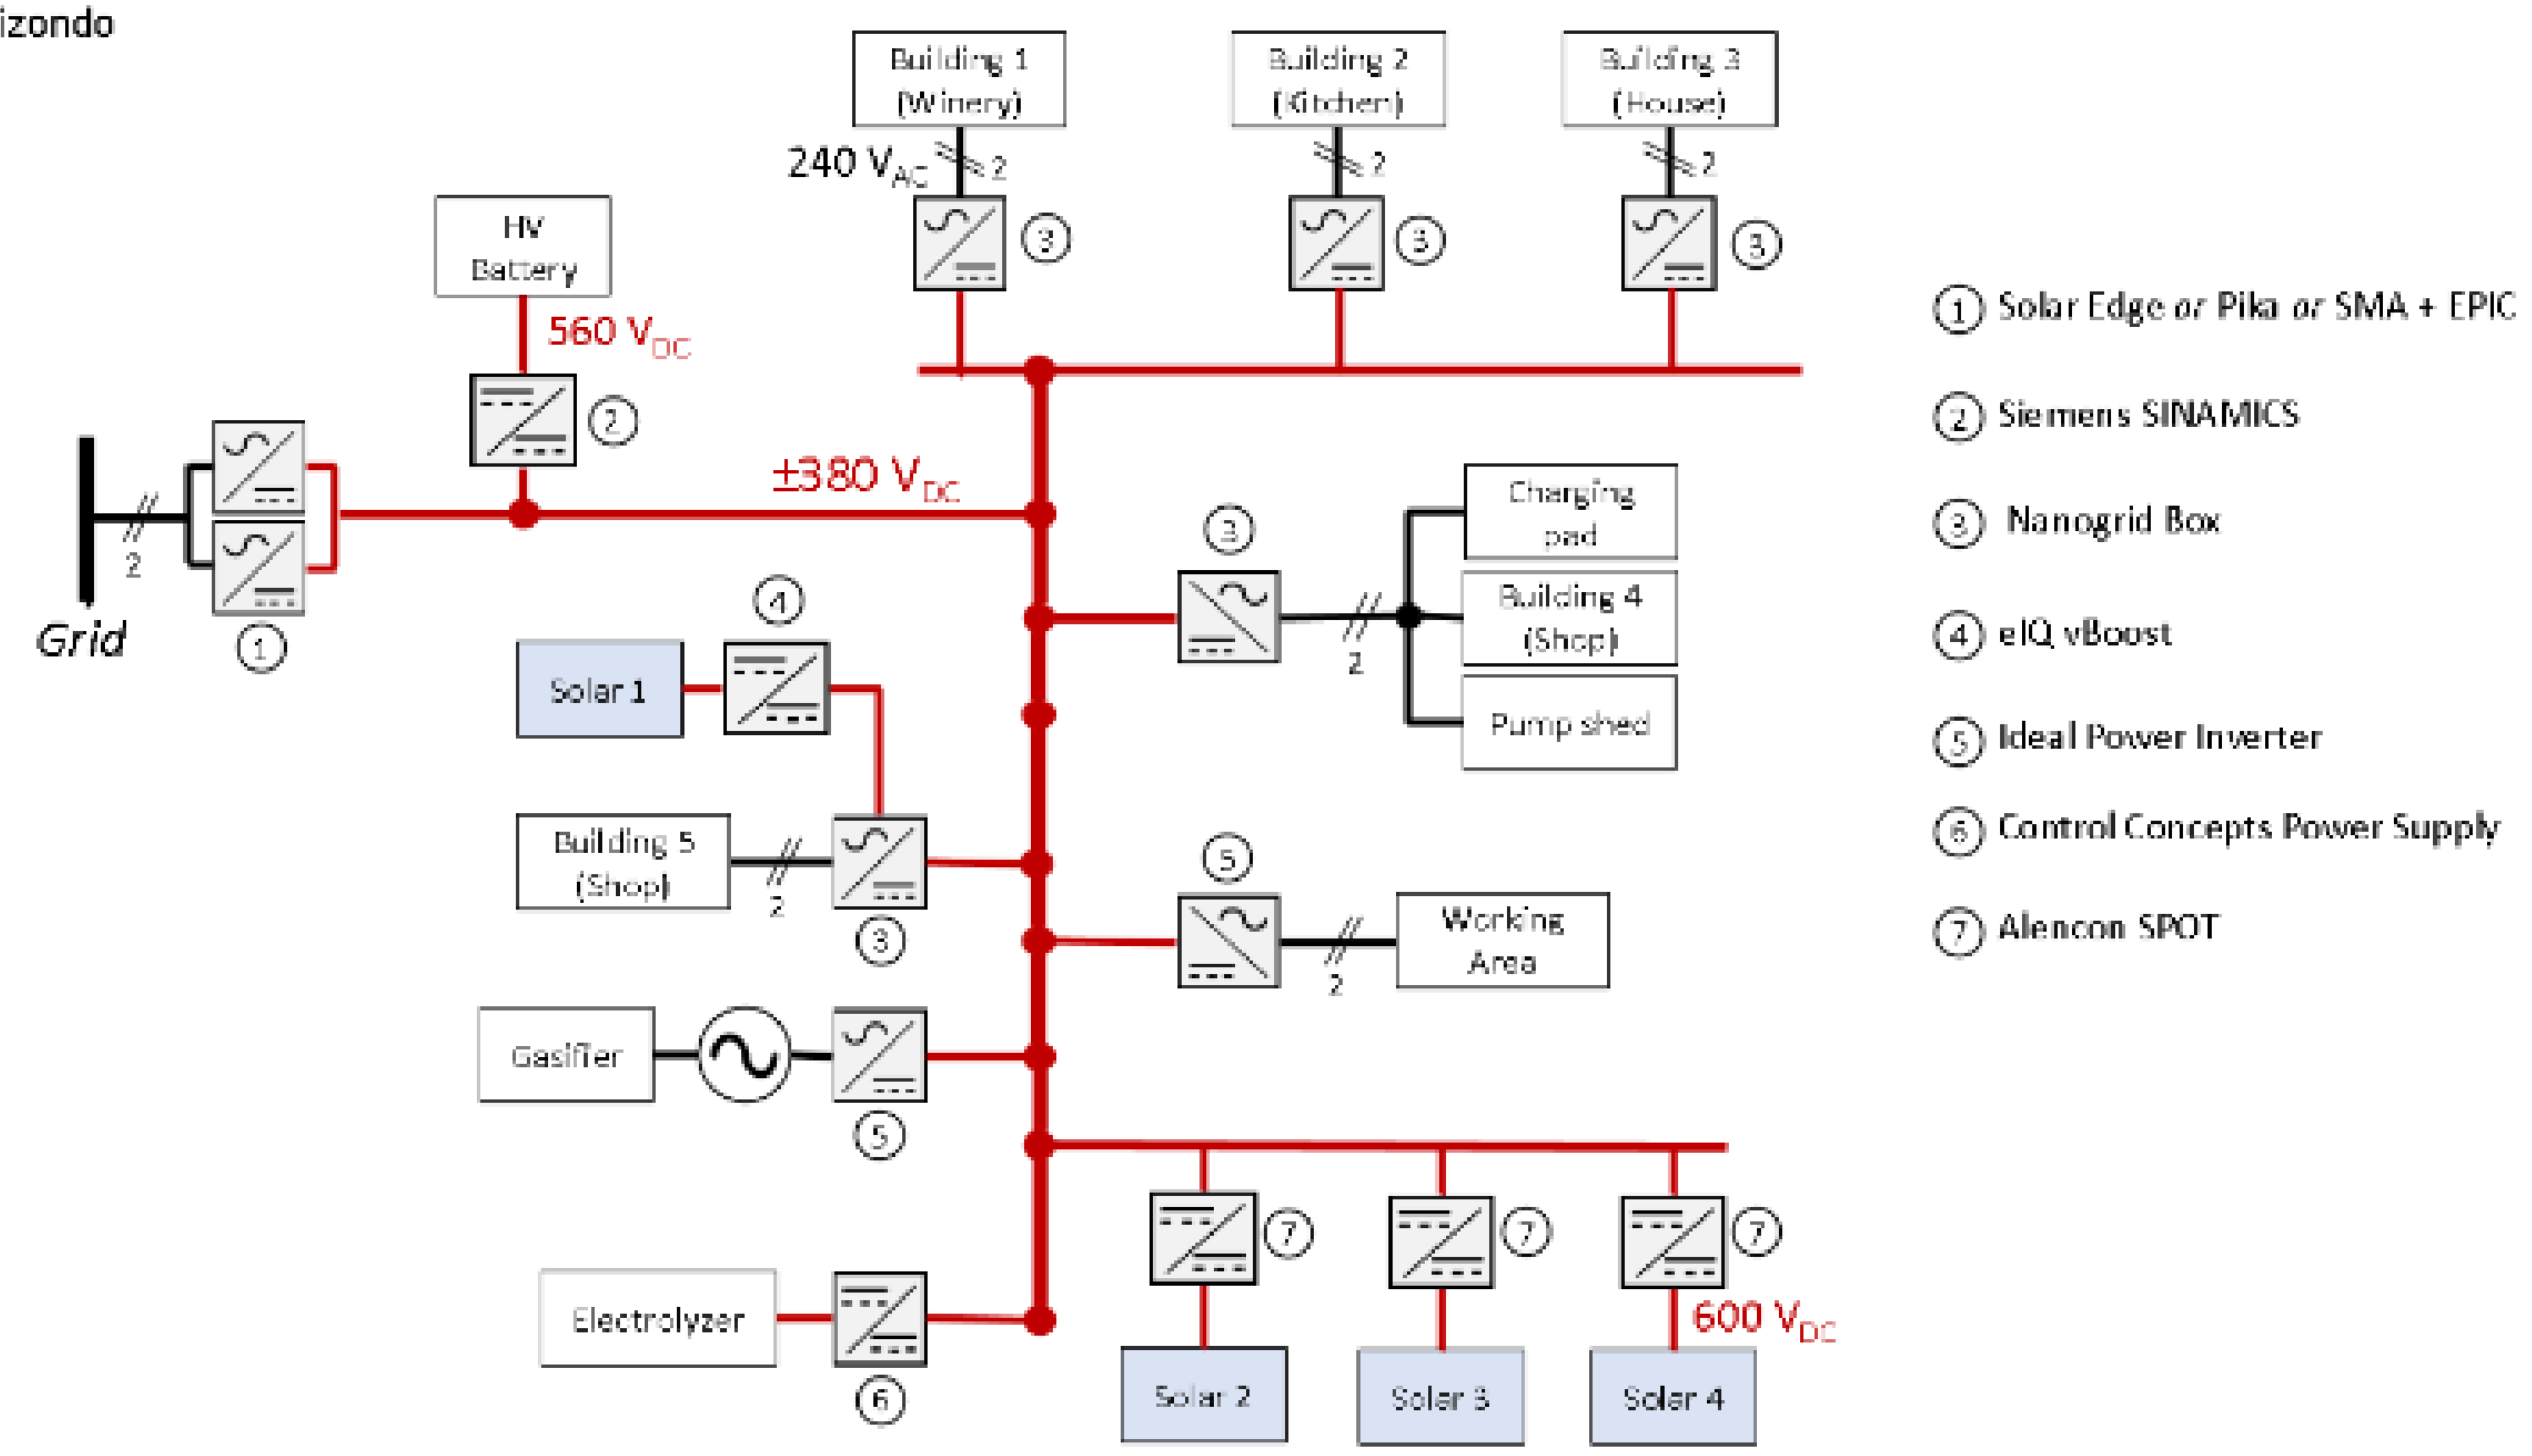

Silver Cloud, Sonoma Co, California 3

US Academic DC Research Centers

National Labs (NREL, LBNL)

FREEDM Center, North Carolina State U

Powerhouse, Colorado State U

CAPS Center, Florida State U

US Department of Energy
Clean Energy Research Center (CERC) Program

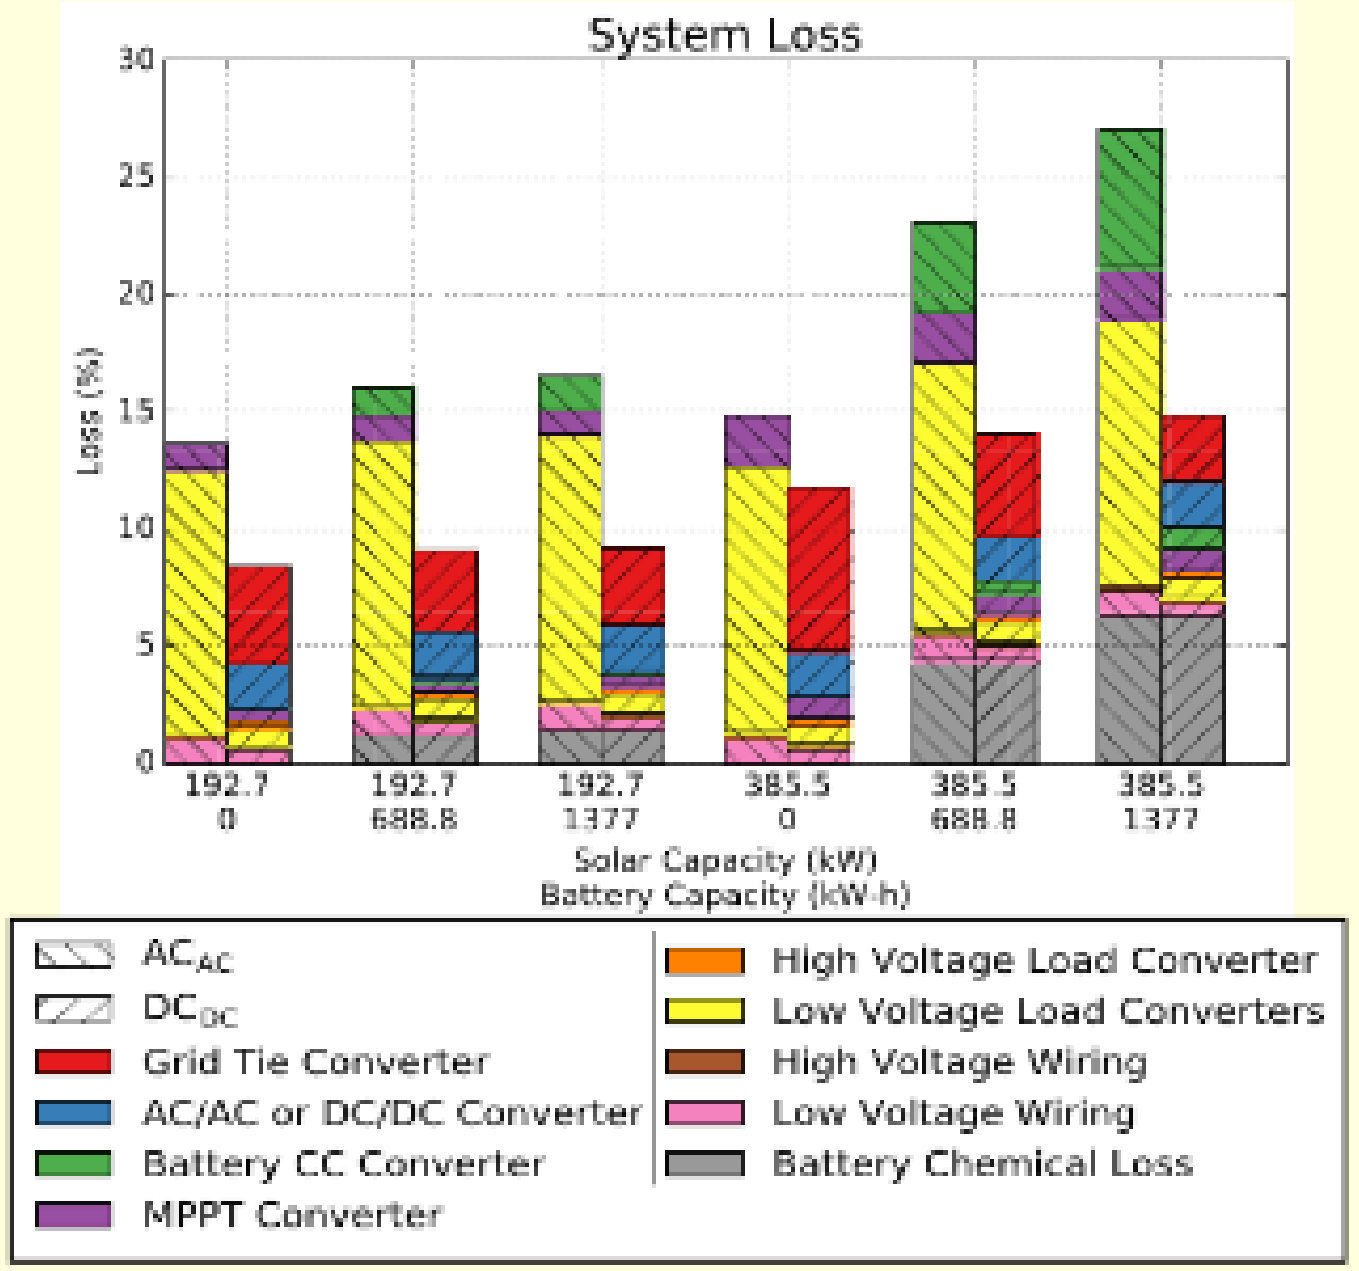

Description	Network	Average LCC Savings (US$)
Total First Cost ($)	AC	252,000
	DC	301,000
Net Annual Electricity Consumption (kWh/yr)	AC	177,000
	DC	101,000
Average LCC Savings ($)	AC vs. DC	61,000
% Cases with Net Benefit	AC vs. DC	>90%
Average Payback Period (yr)	AC vs. DC	~1

$$\text{Payback} = \frac{\text{First Cost}_{\text{DC System}} - \text{First Cost}_{\text{AC System}}}{\text{Operating Cost}_{\text{AC System}} - \text{Operating Cost}_{\text{DC System}}}$$

$$\text{LCC} = \text{First Cost} + \sum_{y=1}^{\text{Lifetime}} \frac{\text{Operating Cost}(y)}{(1 + \text{Discount Rate})^y}$$

Research Goals

- Compare AC and DC buildings
- Simulations to determine efficiency savings
- Conduct techno-economic analysis
- Experimental validation (next slide)

Efficiency Results

- 12% baseline efficiency savings with DC
- Most savings with large solar and battery
- Dominant AC loss: **wall adapters**
- Dominant DC loss: **grid-tie inverter**

Techno-Economic Analysis

- Results determined from market cost data, grid tariffs, and Monte-Carlo analysis
- First cost is higher for DC
- With significant efficiency savings, the payback period is less than a year

California Energy Commission
Direct DC Plug Loads for ZNE Buildings

Research Goals

- Modify AC plug loads for direct-DC input
- Demonstrate savings in consumption and cost

Task Lamp
15 V USB-C
~5% W saved

Bath Fan
48 V PoE
8-15% W saved

Refrigerator, 380 V DC, 1% W saved
(since original doesn't have PFC)

Zone Light, 380 V DC, 6% W saved

Team

Michael Deru
Mechanical engineer with expertise in integration and validation of high efficiency building systems

Willy Bernal
Electrical engineer with expertise on benchmarking emerging green technologies and microgrids configuration and operation

Stephen Frank
Electrical engineer focused on controls and optimized electricity distribution systems for buildings

Omkar Ghatpande
Electrical engineer with expertise in design and manufacturing of renewable power distribution systems

Richard Brown
Systems engineer with expertise in integration and validation of networked controls and power systems in buildings

Bruce Nordman
Architect focused on networked controls and local power distribution in buildings

Vagelis Vossos
Physicist focusing on efficiency versus cost-effectiveness in building systems and equipment, with several publications on DC systems.

Daniel Gerber
Electrical engineer with expertise modeling and prototyping efficient power electronics for DC power

NREL/LBNL DC Design Tool

Research Goals

- Develop an Energy Design and Scoping Tool for DC systems
- Target audience: building planners, designers, and engineers who are considering deployment of DC distribution systems
- Extends DOE's tools: EnergyPlus and the OpenStudio
- Enable user to assess and compare the energy efficiency and life-cycle cost of a design
- Validate the DC Design Tool using collected experimental and field data

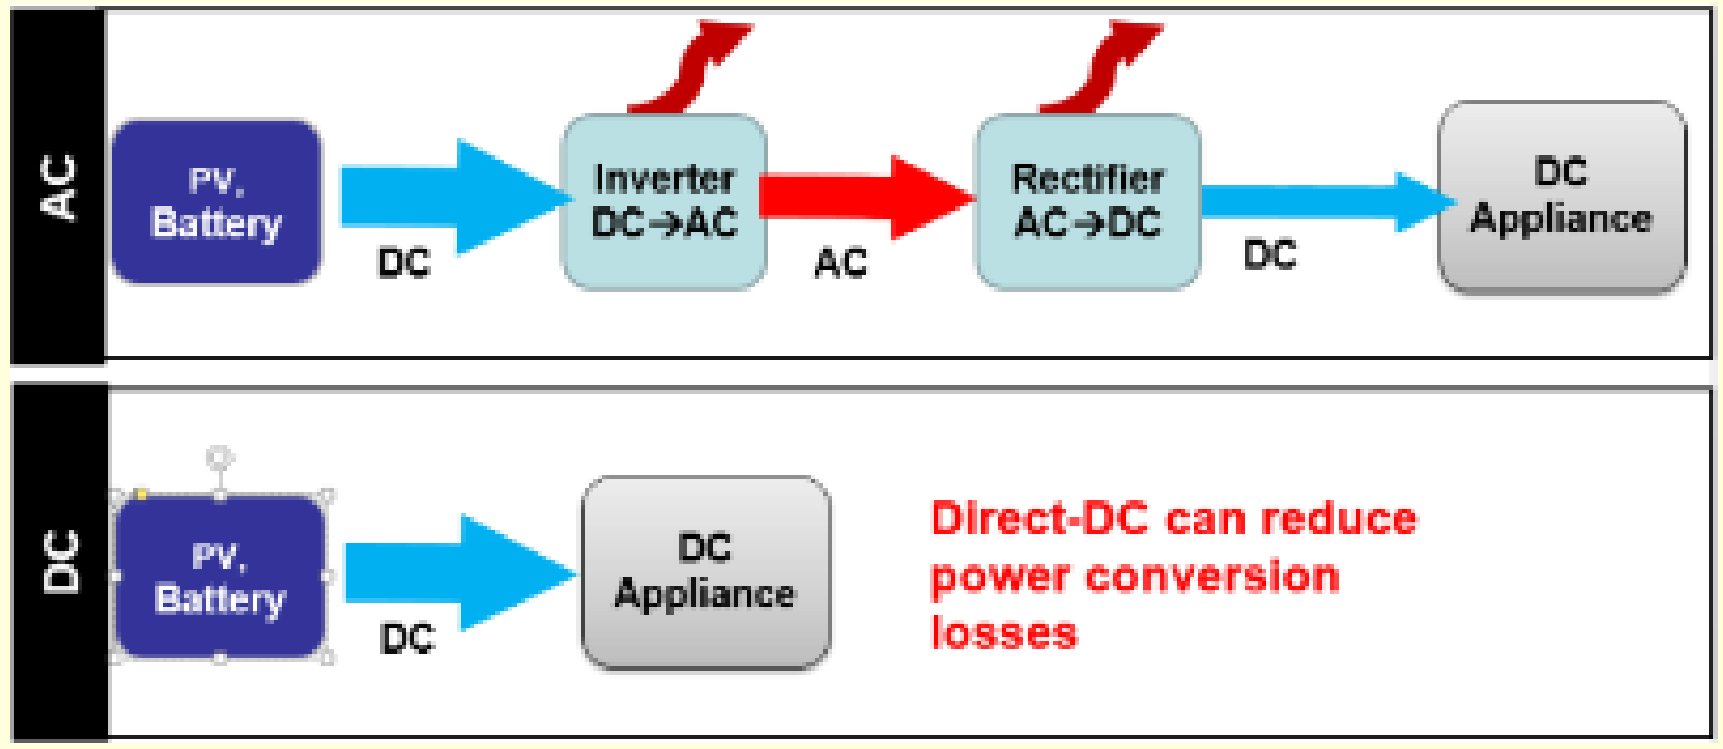

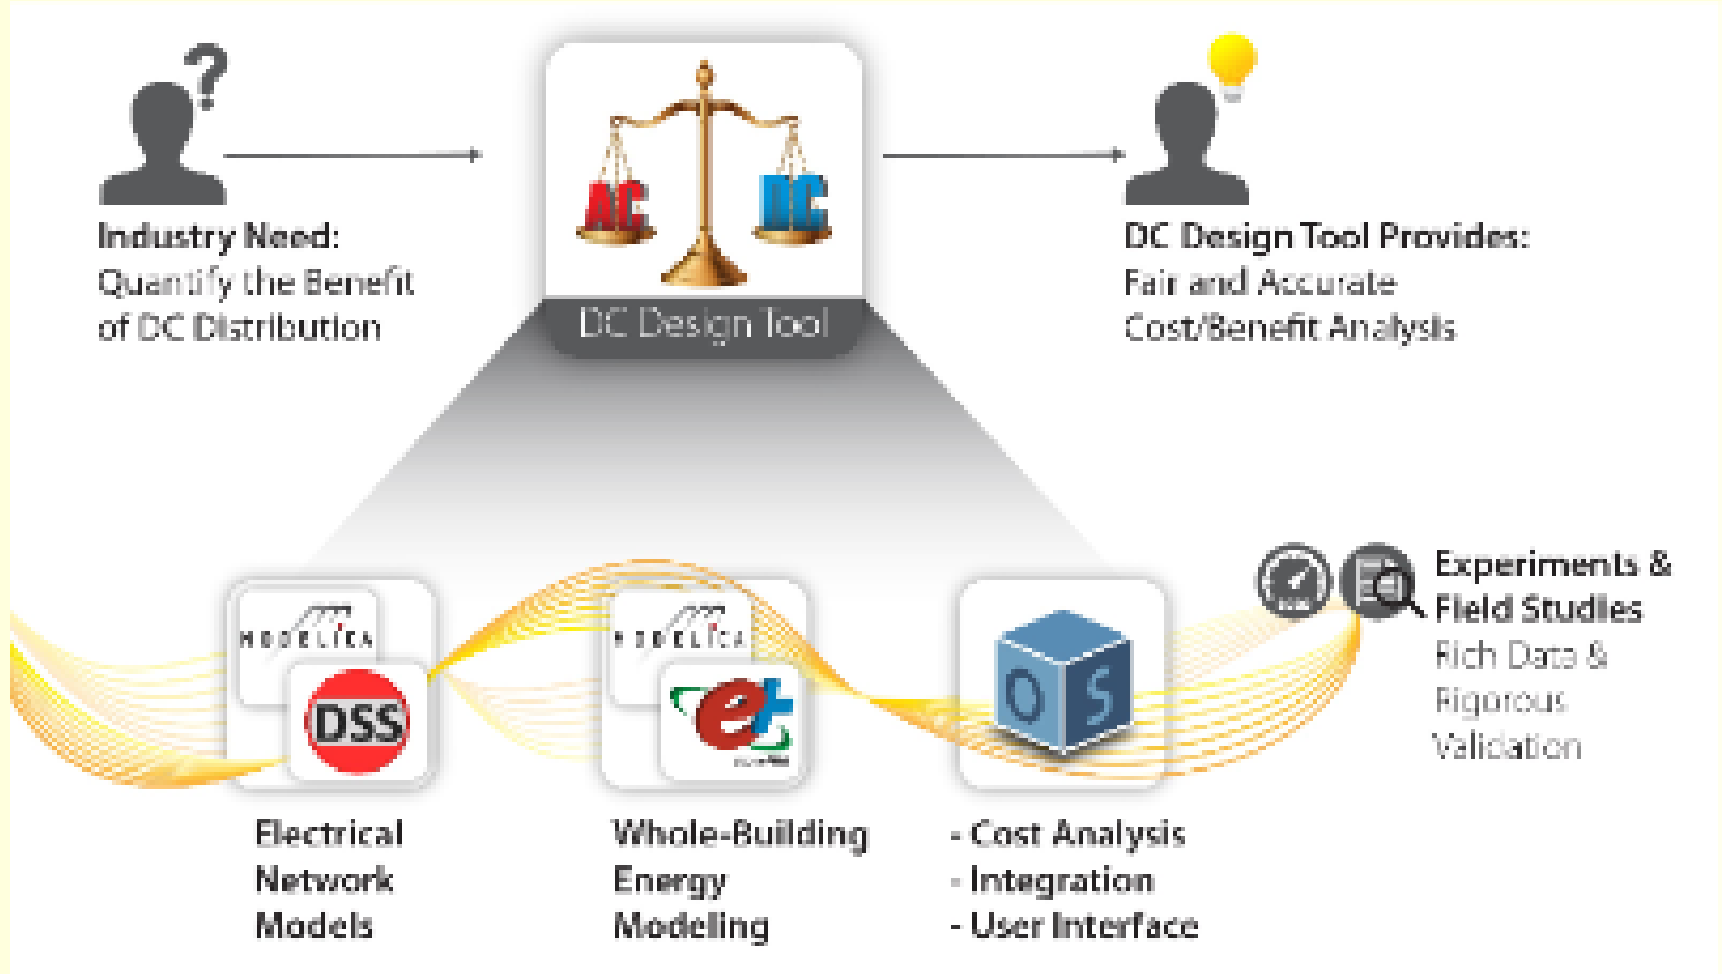

NRECL/LBL DC Field Testing

Research Goals

- Establish evaluation methods and metrics for DC-systems
- Measure and evaluate the performance of several buildings with new DC distribution installations
- Assess technical barriers inhibiting robust adoption of DC systems
- Identify opportunities to optimize DC-system performance

Xingye Solar
Shenzhen

IBEW Building
San Leandro

Marriott Sinclair
Fort Worth

IBR Building
Shenzhen

Fort Collins 2019 Symposium on Microgrids

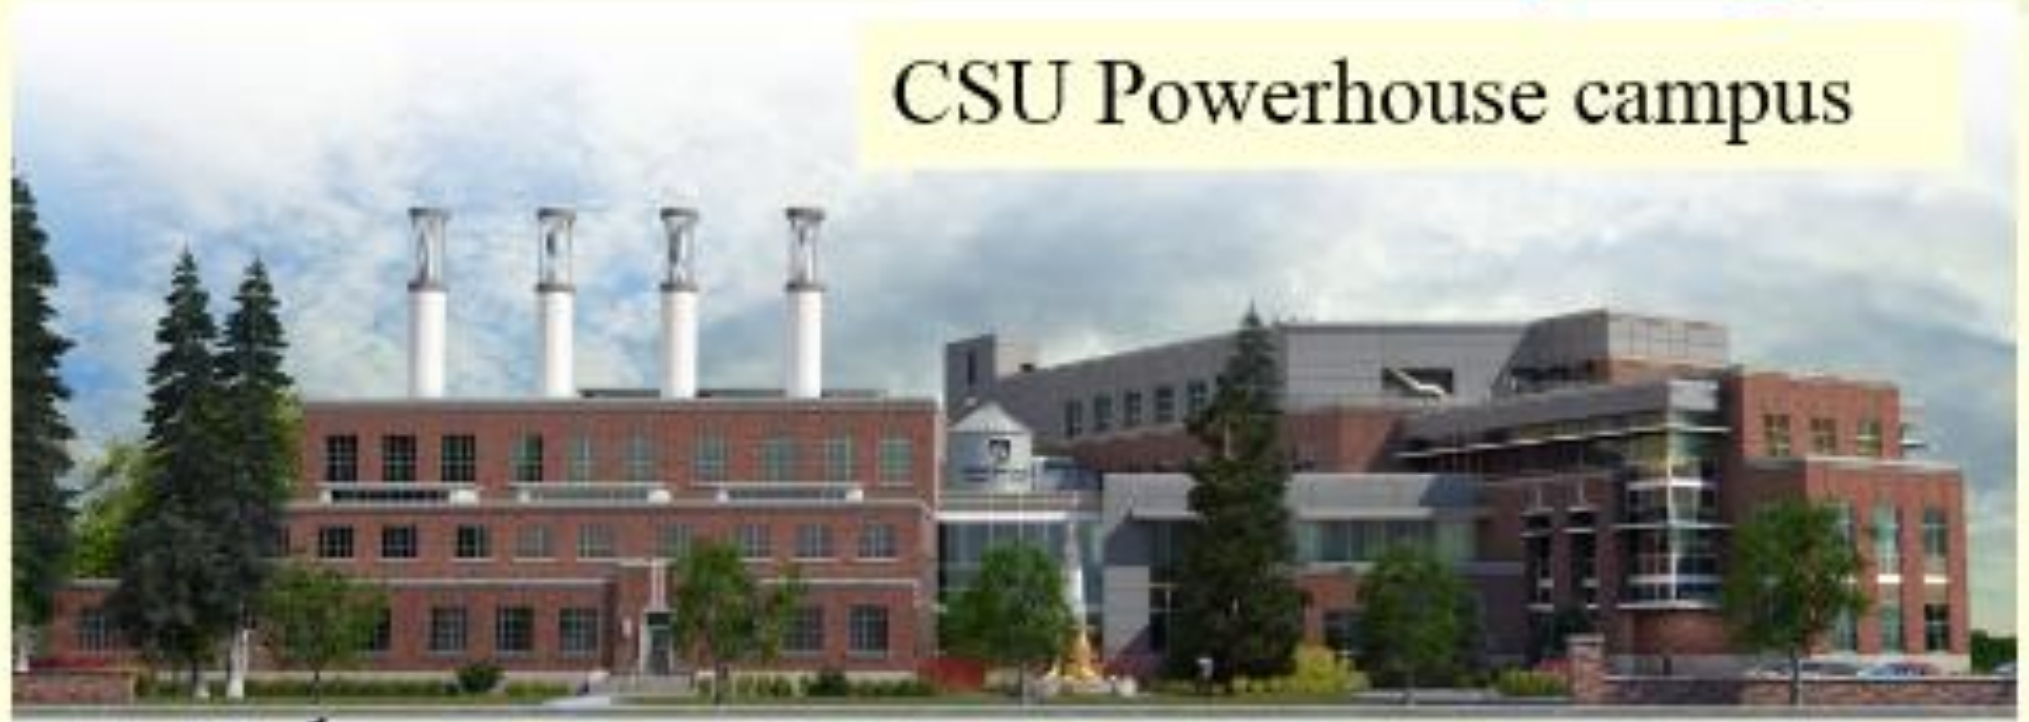
CSU Powerhouse campus

- 15^{th} in Microgrid Symposium serie
- 9-12 August 2019 on Colorado State University campus
- by invitation only
- limited to 120-140 experts

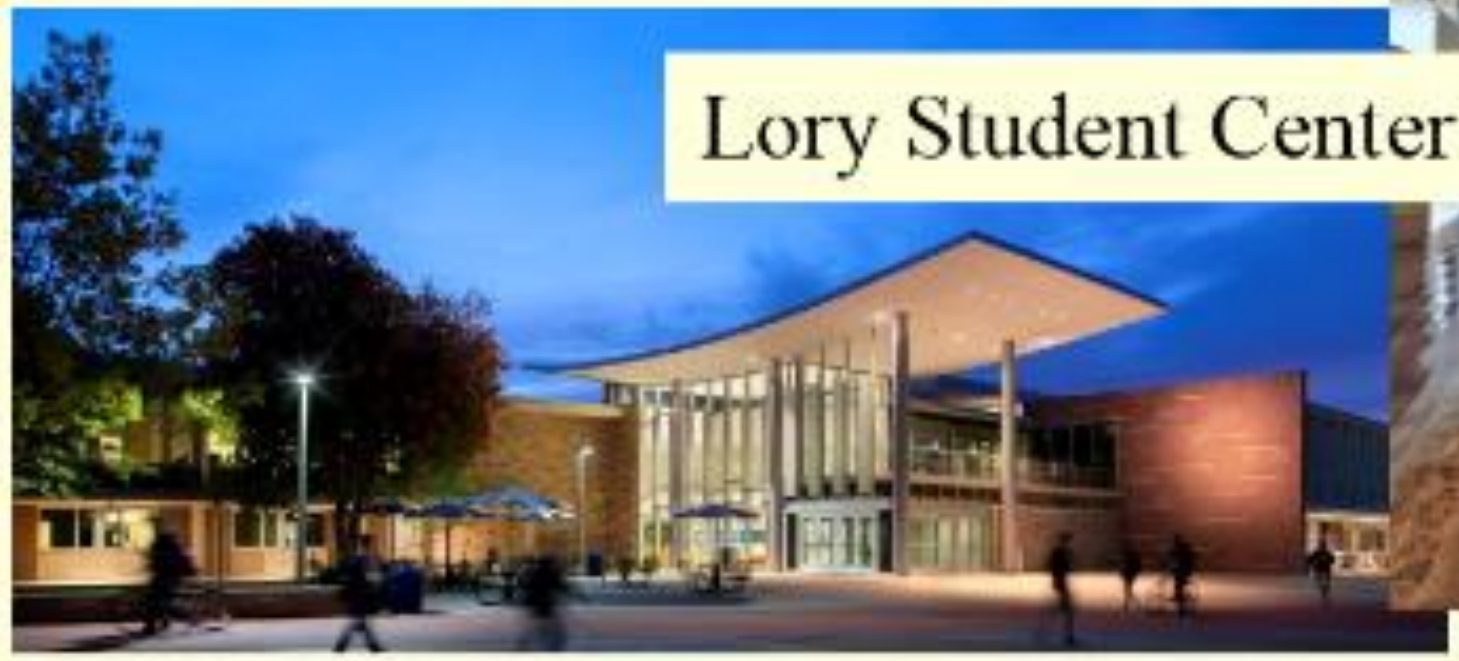
Lory Student Center

Arigatou gozaimasu!
ありがとうございます。

Chris Marnay & Daniel Gerber

Microgrid Design of Mendocino & Berkeley Lab
chris@mgdom.com -+- ChrisMarnay@LBL.gov
Daniel Gerber -+- DGerb@LBL.gov

other Berkeley Lab collaborators: Vagelis Vossos, Wei Feng, Aditya Khandeckar, Rich Brown, & Bruce Nordman